
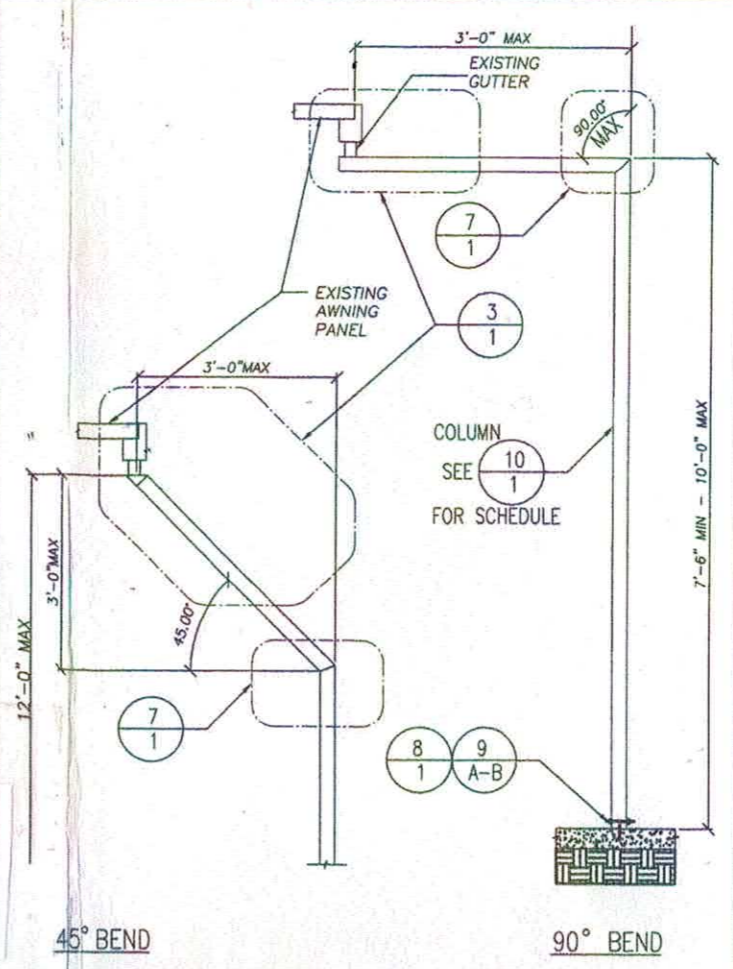
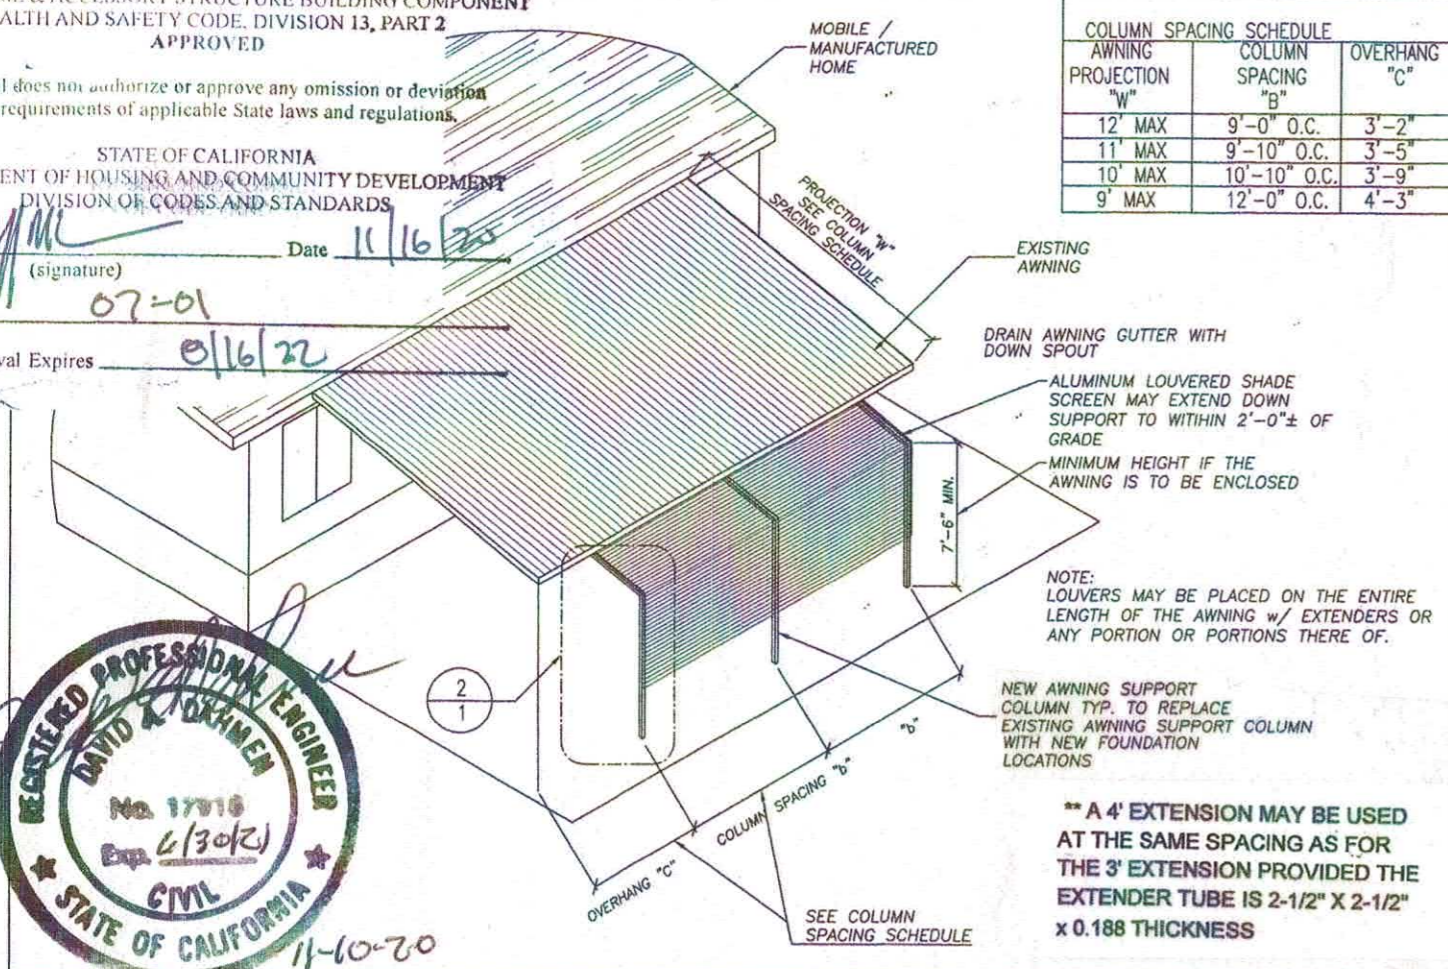


Approval does not authorize or approve any omission or deviation from requirements of applicable State laws and regulations.

STATE OF CALIFORNIA
DEPARTMENT OF HOUSING AND COMMUNITY DEVELOPMENT
DIVISION OF CODES AND STANDARDS

Date 11/16/20
P NO 07-01
his Approval Expires 01/16/22







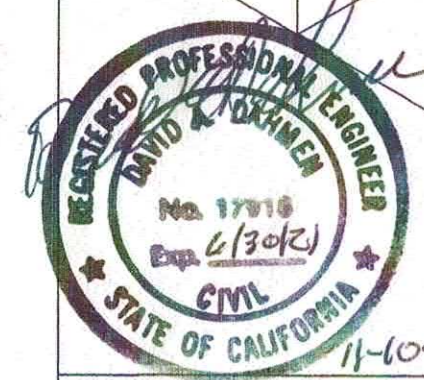


- GENERAL NOTES:**
- THIS AWNING SUPPORT PLAN IS DESIGNED FOR USE WITH MANUFACTURED AND / OR MOBILE HOMES.
 - DESIGN LOADS **2019 CRC**
VERTICAL WIND
D.L. = 1.0 PSF HORIZONTAL = 10.0 PSF
L.L. = 10.0 PSF UPLIFT = 10.0 PSF
T.L. = 11.0 PSF
 - THE AWNING MAY BE ENCLOSED PER AWNING MANUFACTURERS APPROVED PLAN
 - ALL WORK SHALL BE IN ACCORDANCE WITH THE 2007 EDITION OF THE CALIFORNIA BUILDING CODE, THE CALIFORNIA CODE OF REGULATIONS TITLE 25 AND LOCAL CODES.
 - BEARING CAPACITY OF NATURAL SOIL OR COMPACTED FILL SHALL EQUAL OR EXCEED 1500 PSF PER C.B.C. TABLE 1804A.2 LATERAL BEARING CAPACITY SHALL EQUAL OR EXCEED 100 PSF PER C.B.C. TABLE 1804A.2. THIS AWNING SUPPORT SHALL NOT BE LOCATED IN AREAS WITH EXPANSIVE SOILS, AND/OR SOILS OTHER THAN AS INDICATED IN C.B.C. TABLE 1804A.2.
 - EXISTING AWNING SLOPE SHALL BE MAINTAINED BUT SHALL BE LESS THAN 1" PER FOOT MINIMUM.
 - STEEL SHALL CONFORM TO A.S.T.M. SPECIFICATION FOR MINIMUM YIELD STRENGTH OF 36,000 PSI, UNLESS OTHERWISE NOTED.
 - HOLES FOR BOLTS IN STEEL SHALL BE A BOLT DIA. +/- 1/16" MAXIMUM.
 - BOLTS SHALL BE A.S.T.M. GRADE A307, GALVANIZED OR STAINLESS STEEL (SS)
 - WELDING SHALL BE DONE WITH 70,000 PSI. ELECTRODE OR EQUAL BY A QUALIFIED WELDER IN AN APPROVED SHOP.
 - FASTENERS IN PRESSURE TREATED WOOD SHALL BE STAINLESS STEEL (S.S.).
 - CONTRACTORS SHALL VERIFY ALL SITE CONDITIONS & DIMENSIONS AND NOTIFY ENGINEER OF ANY DISCREPANCIES. CONTRACTOR SHALL BE RESPONSIBLE FOR SHORING AWNING BEFORE REPLACING SUPPORTS.
 - RESEAL THE AWNING TO MFG'D HOME CONNECTION AFTER INSTALLATION OF THE EXTENDERS.

REVISIONS	BY
10-27-99	T.L.W.
11-20-99	T.L.W.
8-25-01	T.L.W.
8-29-01	T.L.W.
7-28-06	T.L.W.
9-22-08	T.L.W.

Pacific Consulting Engineers
9739 North Vista Drive
Kingman, AZ 86401
Phone 916-296-7376

MOBILE HOME AWNING & SUPPORTS

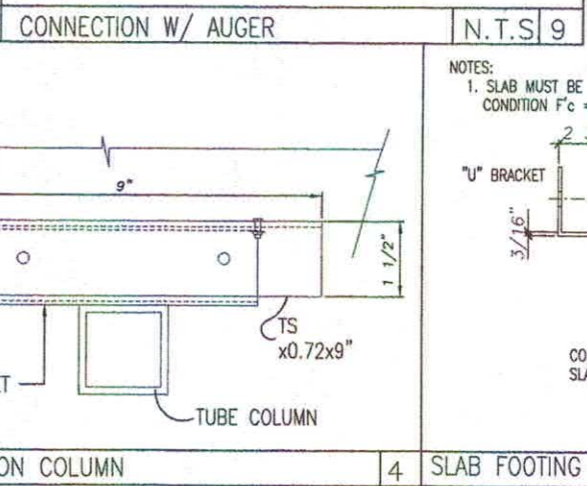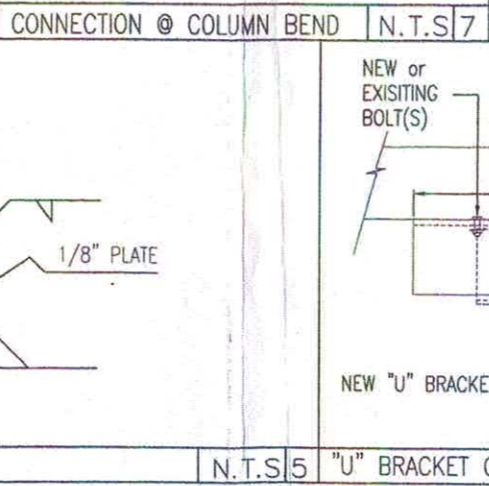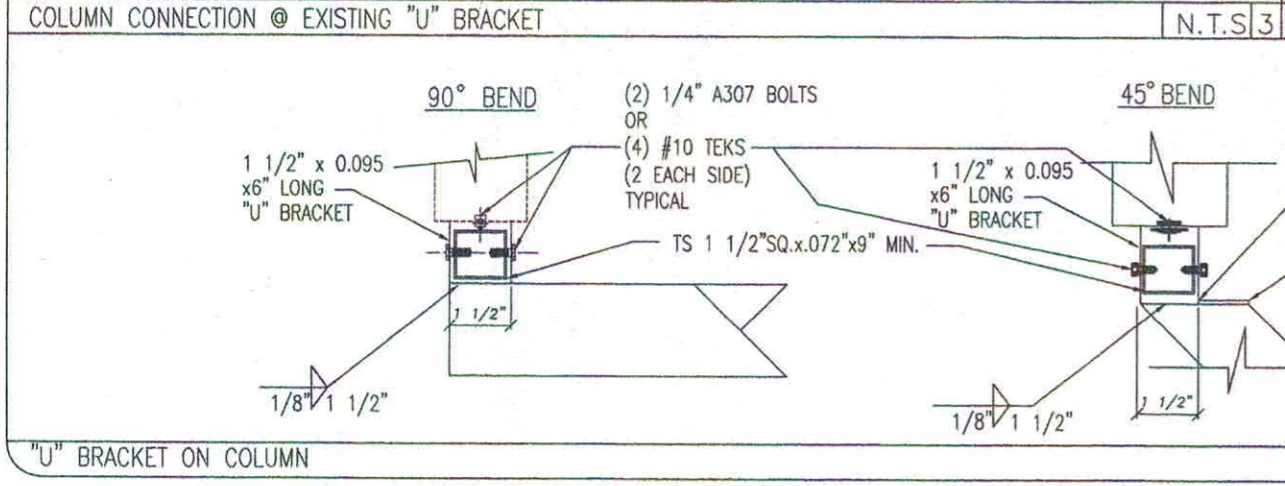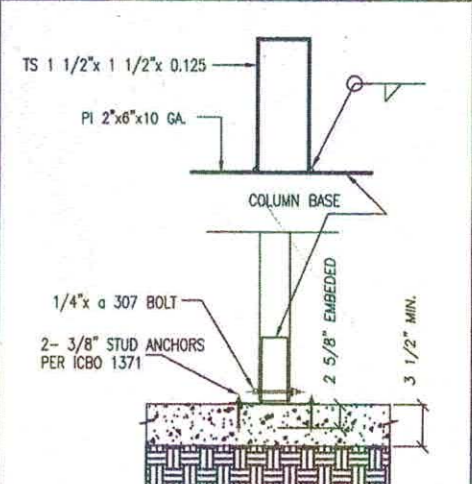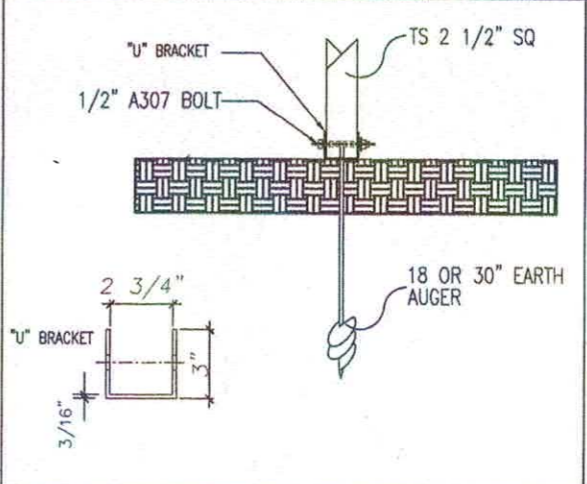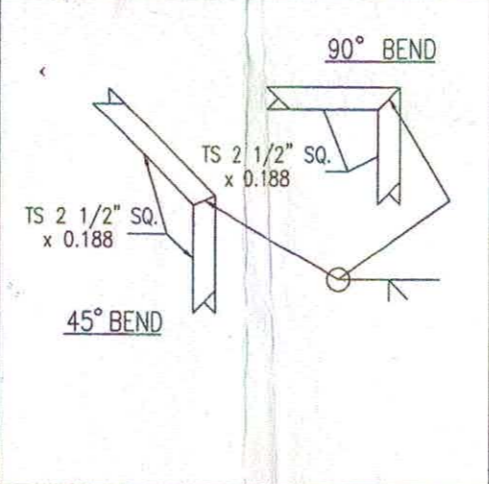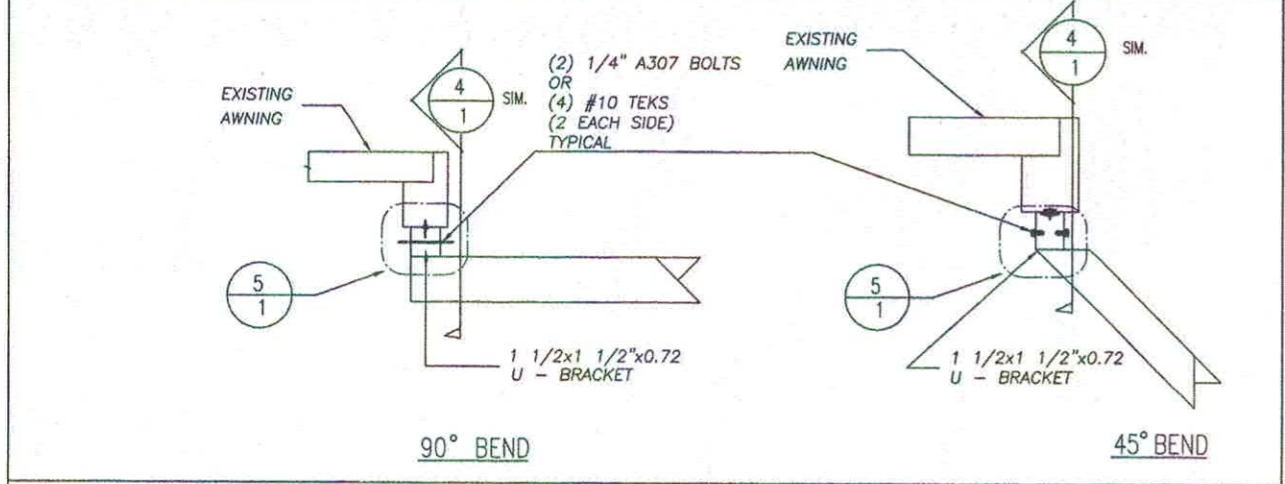

ABESCO
5851 FLORIN-PERKINS ROAD
SACRAMENTO CA 95828

AWNING EXTENDERS

DRAWN: T. Wallace
DATE: 8-31-99
SCALE: N.T.S.
Sheet # **A-1**

1 OF 1 SHEETS